

TECHNICAL DATA SHEET

**LPI[®] STORMMASTER ESE**

- Fully Tested Air Terminals in Compliance to NF C 17-102 (2011)
- Family of Stainless Steel Air Terminals
- Easy to Install
- All Stormmaster Terminals Tested by the ITE HV Laboratory in Europe, which has National (ENAC, UNE) and International (ILAC / ISO / IEC) Accreditation

- Cost Effective Lightning Protection
- Free Lightning Protection Designs & Risk Assessments Available on Request
- For connection to HVSC Plus or 2 inch GI pipe



TECHNICAL DATA SHEET

LPI® STORMASTER ESE

Protection Performance

The protection radius (R_p) of a Stormaster ESE terminal is calculated using the formula defined by the French National Standard NF C 17-102 (September 2011), namely:

$$(1) R_p[h] = \sqrt{2rh - h^2 + \Delta[2r + \Delta]} \text{ for } h \geq 5 \text{ m}$$

and

$$(2) R_p = h \times R_{p5} / 5 \text{ for } 2 \leq h < 5 \text{ m}$$

Where h = actual height of Stormaster terminal above the area to be protected (m).

R_{p5} = value of R_p from Eqn. [1] when $h = 5 \text{ m}$

r = 20 m for protection level I [Very High protection]
 30 m for protection level II [High protection]
 45 m for protection level III [Medium protection]
 60 m for protection level IV [Standard protection]


Δ = Stormaster time and height advantage according to the Stormaster model installed:

Stormaster-ESE-15: $\Delta = 15 \mu\text{s}$

Stormaster-ESE-30: $\Delta = 30 \mu\text{s}$

Stormaster-ESE-50: $\Delta = 50 \mu\text{s}$

Stormaster-ESE-60: $\Delta = 60 \mu\text{s}$

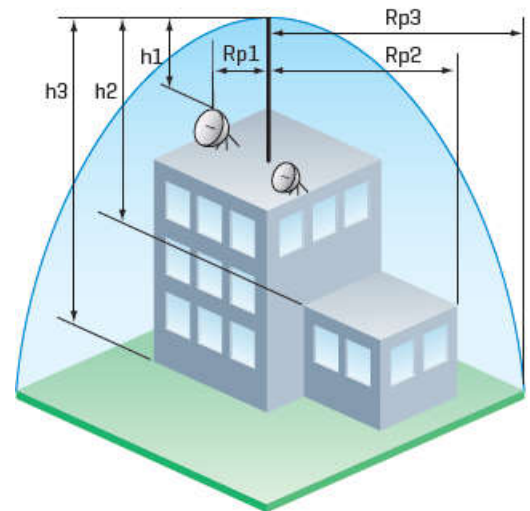

PROTECTION RADIUS, R_p (m)										
h = height of Stormaster ESE terminal above the area to be protected (m)	2	4	5	6	10	15	20	45	60	100
Protection Level I (Very High)										
Stormaster ESE 15	13	25	32	32	34	35	35	35	35	35
Stormaster ESE 30	19	38	48	48	49	50	50	50	50	50
Stormaster ESE 50	27	55	68	69	69	70	70	70	70	70
Stormaster ESE 60	31	63	79	79	79	80	80	80	80	80
Protection Level II (High)										
Stormaster ESE 15	15	30	37	38	40	42	44	44	44	44
Stormaster ESE 30	22	44	55	55	57	58	59	59	59	59
Stormaster ESE 50	30	61	76	76	77	79	79	79	79	79
Stormaster ESE 60	35	69	86	87	88	89	89	89	89	89
Protection Level III (Medium)										
Stormaster ESE 15	18	36	45	46	49	52	55	60	60	60
Stormaster ESE 30	25	51	63	64	66	69	71	75	75	75
Stormaster ESE 50	35	69	86	87	88	90	92	95	95	95
Stormaster ESE 60	39	78	97	97	99	101	102	105	105	105
Protection Level IV (Standard)										
Stormaster ESE 15	20	41	51	52	56	60	63	73	75	75
Stormaster ESE 30	29	57	71	72	75	78	81	89	90	90
Stormaster ESE 50	38	76	95	96	98	100	102	109	110	110
Stormaster ESE 60	43	85	107	107	109	111	113	119	120	120

Contact LPI for Protection Radius for Level I+ and Level I++

NOTE: See the following LPI publications for additional information on the Stormaster range and the NF C 17-102 (2011) Standard (available on request):

- Technical Paper - ESE HV Test Requirements
- Technical Paper – French Standard NF C 17-102 (2011)
- Stormaster Catalogue
- Stormaster Installation Manual

TECHNICAL DATA SHEET


LPI® Product Range

LPI® STORMASTER ESE	1
Protection Performance	2
LPI® Product Range	3
Installation Type 1	4
Installation Type 2	5
Installation Type 3	6
Installation Type 4	7
Installation Type 5	8
Installation Type 6	9
Installation Type 7	10
Section A - LPI® Stormaster ESE Terminals	11
LPI® Stormaster ESE Terminals	12
Standard Adaptor	12
GI Adaptor	12
Stormaster ESE Tester	12
Section B - LPI® Upper Termination Kit	13
Section C - LPI® FRP Support Mast	13
Section D - LPI® Inline Coupling	14
Section E - LPI® Guy Kit	14
Section F - LPI® Guy Ring	15
Section G - LPI® Lower Mast Assembly	15
Section H - LPI® Cantilevering Saddles	16
Section I - LPI® U-Bolt	16
Section J - LPI® Mounting Bracket	16
Section K - LPI® Cable Sock	16
Section L - Downconductors	17
LPI® High Voltage Shielded Cable	17
LPI® Copper Tape	19
LPI® Aluminium Tape	19
LPI® Stranded Copper Cable	19
Section M - LPI® Cable Ties	20
Section N - LPI® Saddles and Fixings	20
LPI® Saddles	20
LPI® D.C Tape Clip	20
LPI® Plastic Tape Clip	Error! Bookmark not defined.
LPI® Square Tape Clamp	21
LPI® Oblong Test Clamp	21
Section O - LPI® Beam Clamp and Cable Support	21
Section P - LPI® Lightning Strike Recorder	22
LPI® Lightning Strike Recorder Tester	22
Section Q - LPI® Lower Termination Kit	23
Section R - LPI® Denso Tape	23
Section S - LPI® Earthing System	24
LPI® Copper Bonded Earth Rods	24
LPI® Stainless Steel Earth Rods	24
LPI® Coupling for Copper Bonded and Stainless Steel Threaded Earth Rods	24
LPI® Copper Tape	25
LPI® Rod to Tape Clamp Type A	25
Section T - LPI® Inspection Pits	26
Section U - LPI® Earthing Compounds	26
LPI® GRIP	26
LPI® RESLO	26
Section V - LPI® Chemical Ground Rod	27
Recommended Earthing Installation	28
ISO 9001 Certificate	28

TECHNICAL DATA SHEET

Installation Type 1

Installation type 1 illustrates a Stormaster system installed on a building roof top (flat roof).

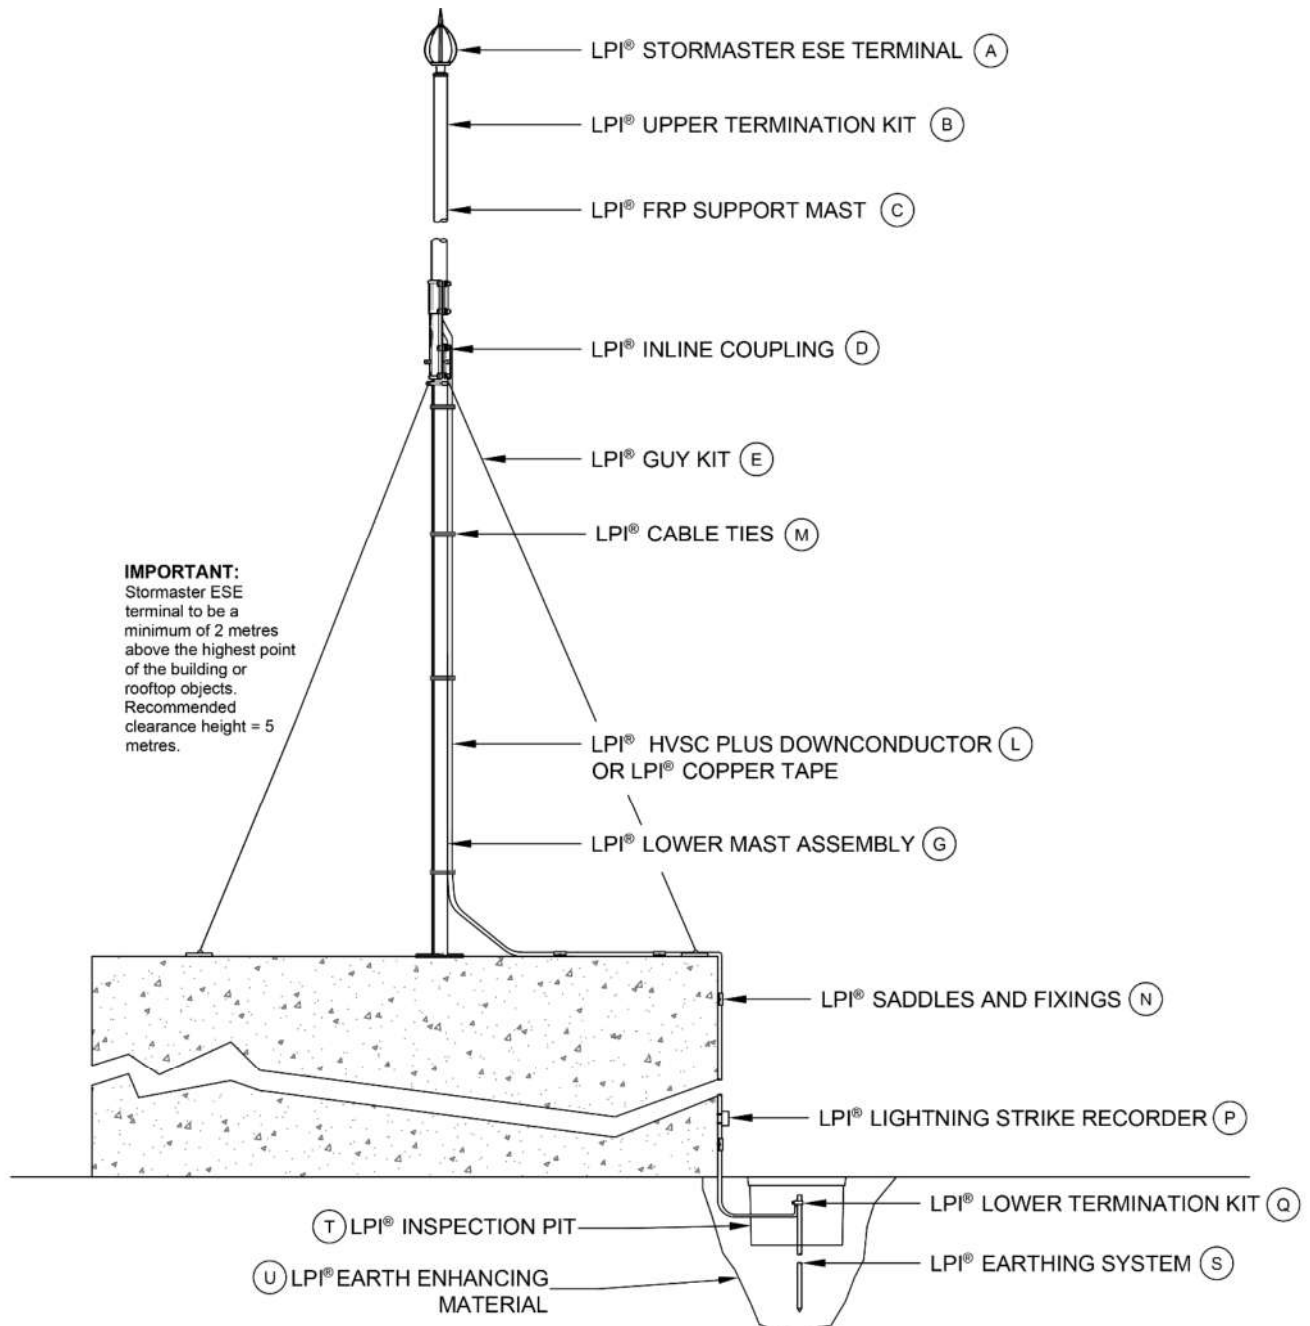


Please refer to page 28 for recommended earthing installation

TECHNICAL DATA SHEET

Installation Type 2

Installation type 2 illustrates a Stormaster system cantilevered to the side wall of a building.

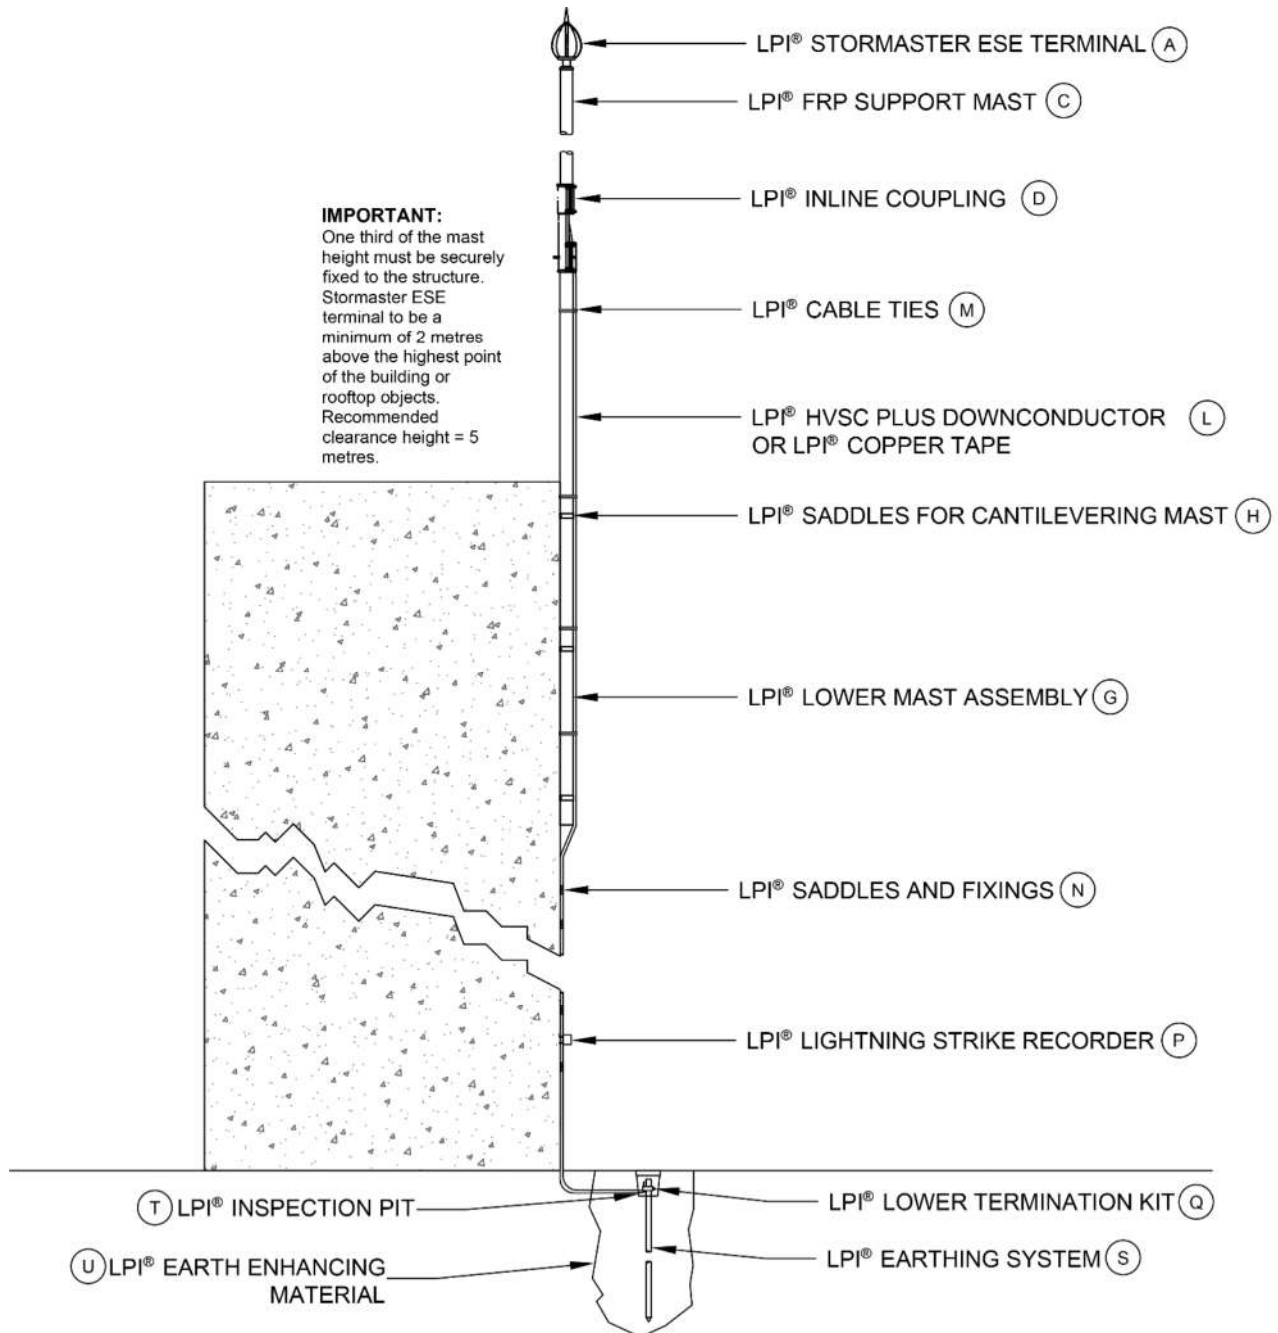


Please refer to page 28 for recommended earthing installation

TECHNICAL DATA SHEET

Installation Type 3

Installation type 3 illustrates a Stormaster system cantilevered to the top section of a tower.

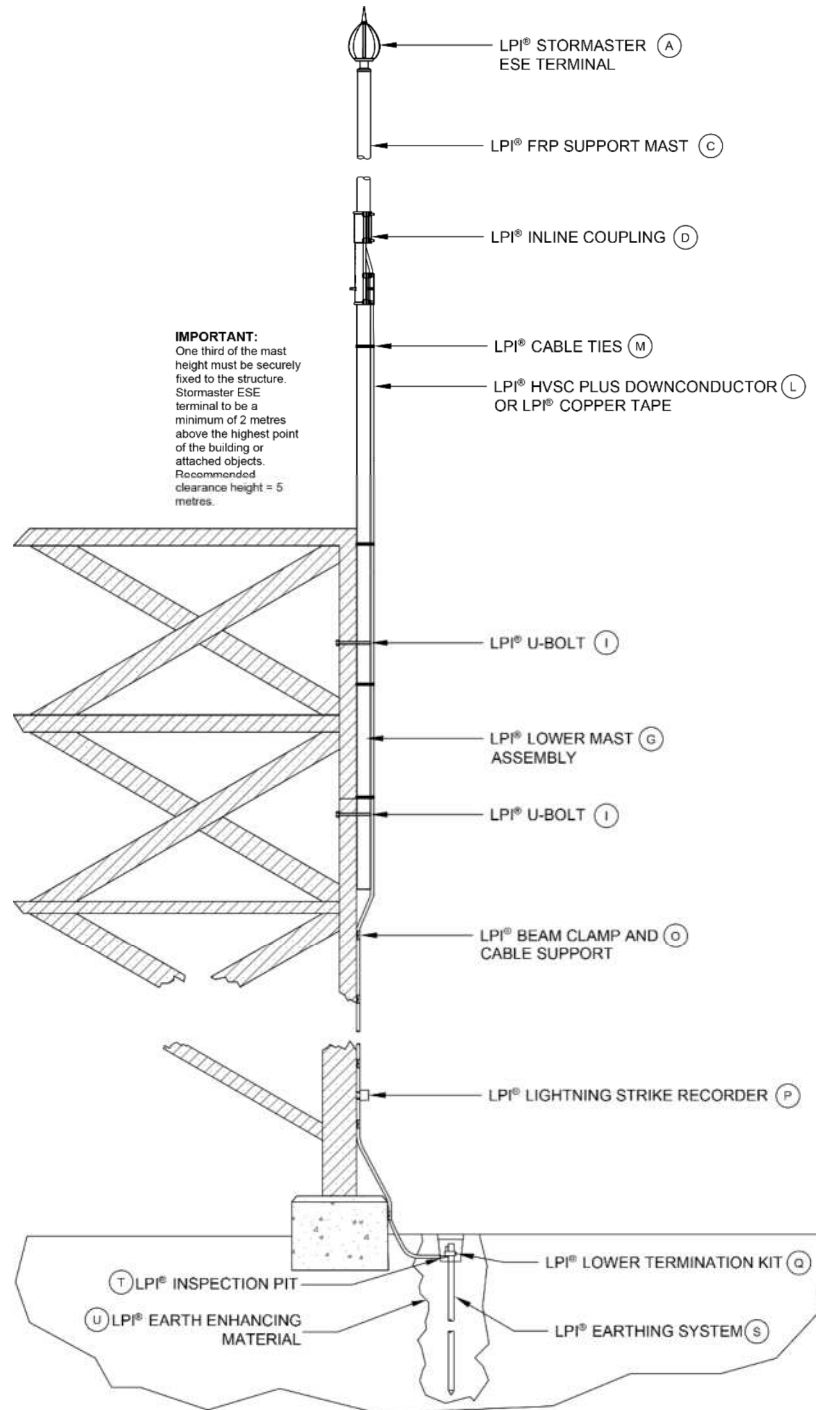


Please refer to page 28 for recommended earthing installation

TECHNICAL DATA SHEET

Installation Type 4

Installation type 4 illustrates a Stormaster system installed on a building roof top (flat roof) or at ground level.

Note: Multiple guying kits are utilized due to increased mast height.

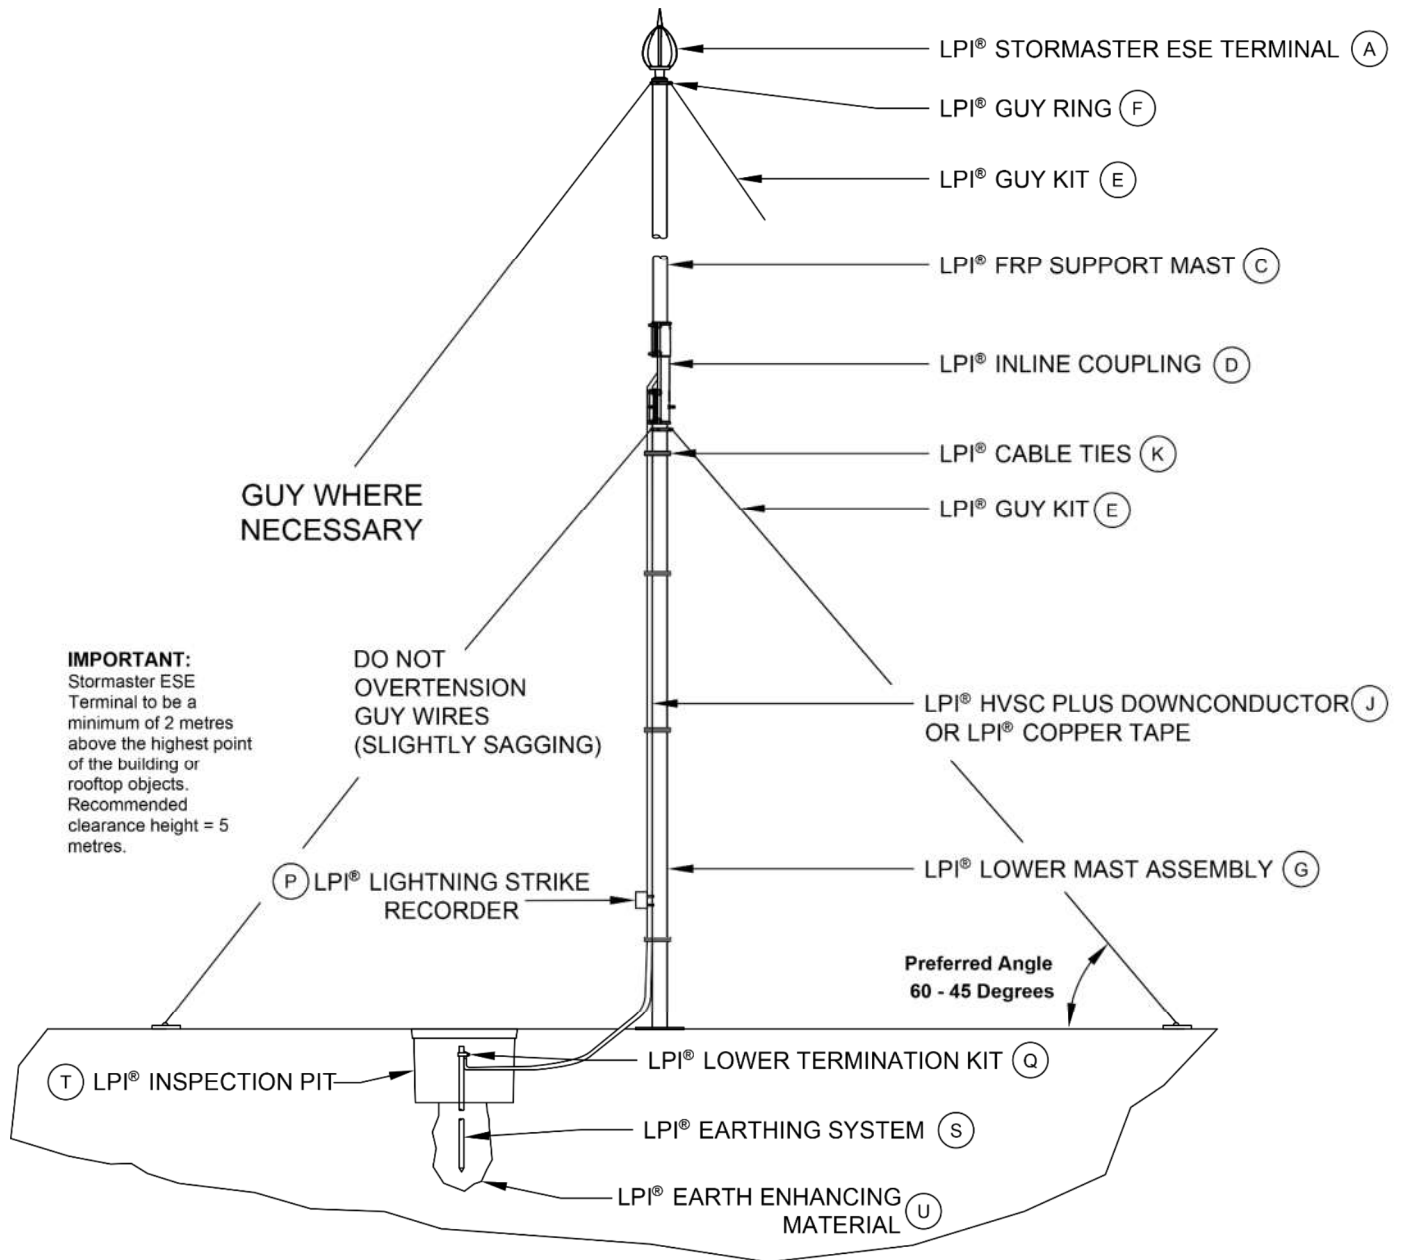


Please refer to page 28 for recommended earthing installation

TECHNICAL DATA SHEET

Installation Type 5

Installation type 5 illustrates typical mounting arrangement for cantilevered GI style Stormaster Terminal.

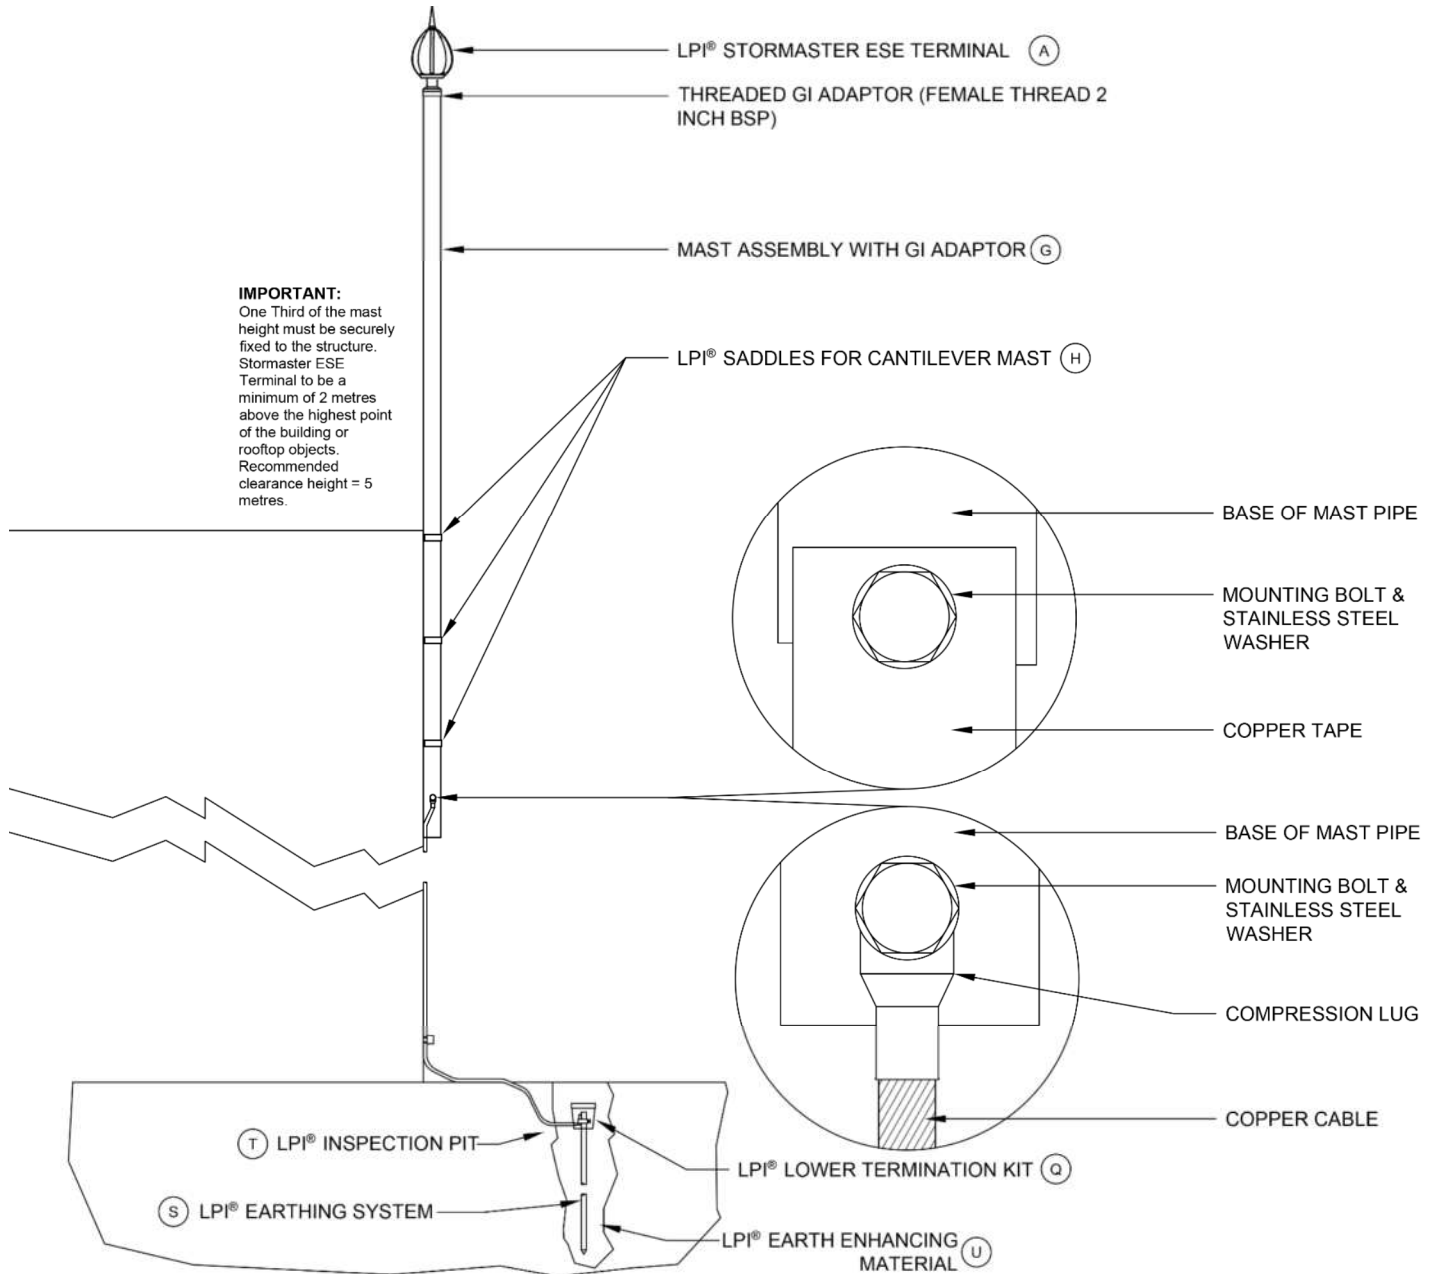


Please refer to page 28 for recommended earthing installation

TECHNICAL DATA SHEET

Installation Type 6

Installation type 6 illustrates typical mounting arrangement for guyed GI style Stormaster Terminal.

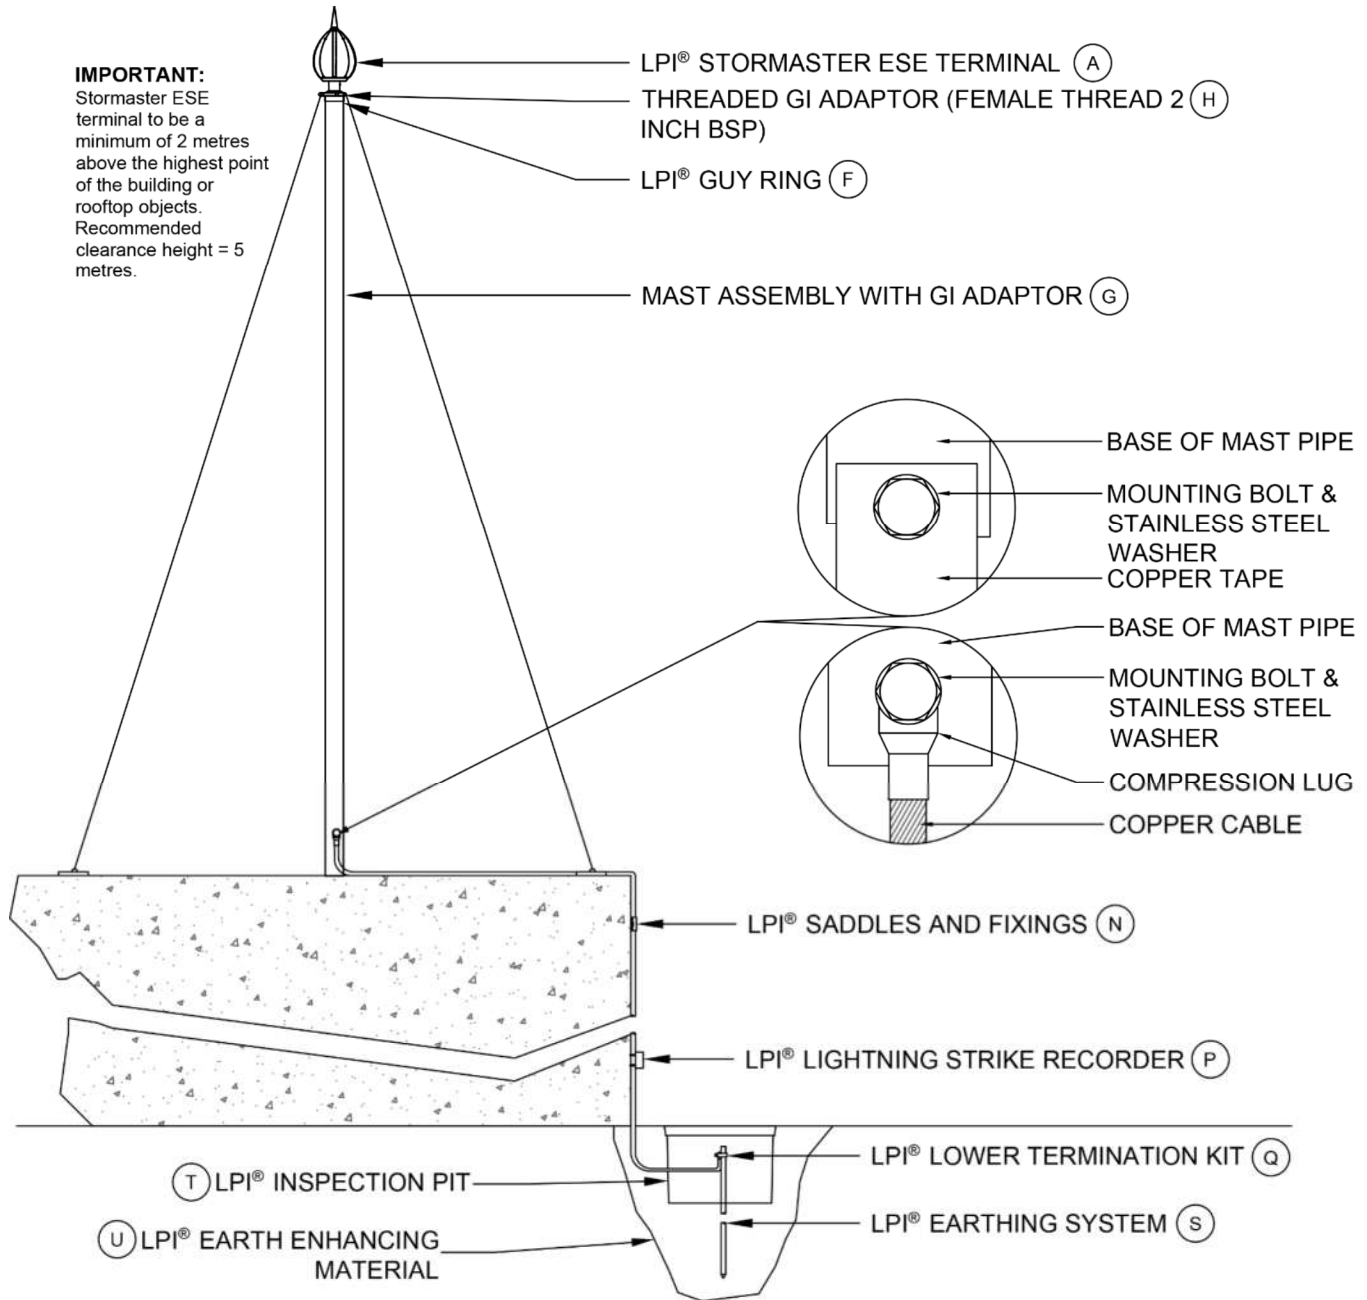


Please refer to page 28 for recommended earthing installation

TECHNICAL DATA SHEET

Installation Type 7



Installation type 7 illustrates typical spigot and cable sock arrangement for freestanding mast style Stormaster terminal

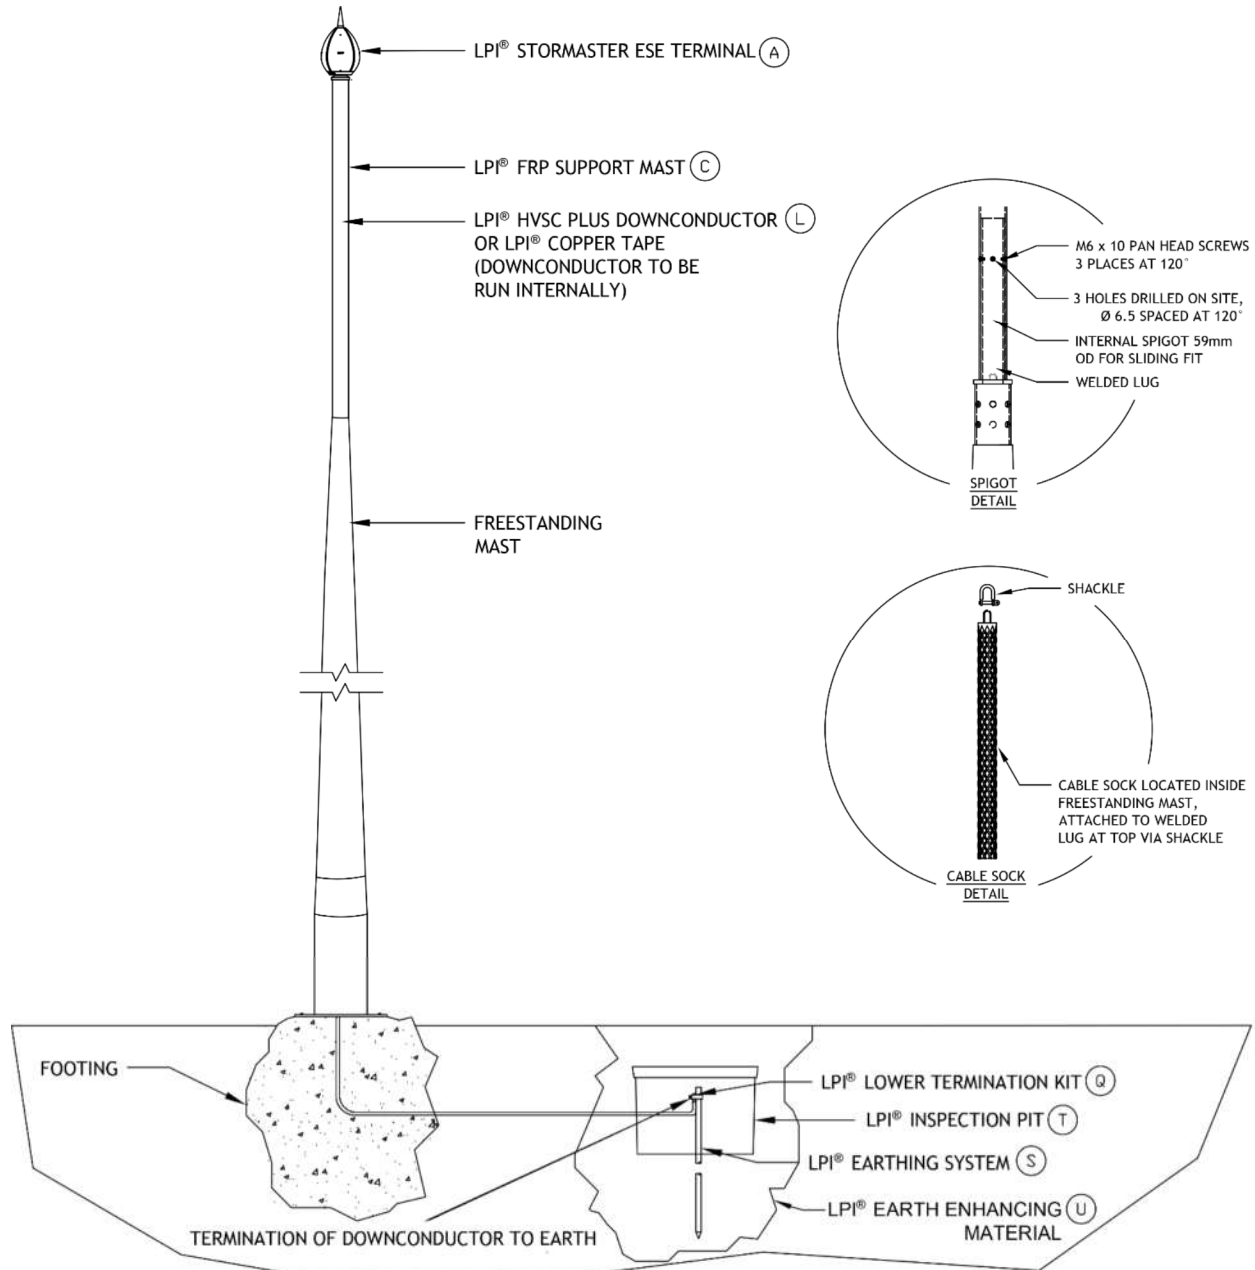

Please refer to page 28 for recommended earthing installation


TECHNICAL DATA SHEET

Section A - LPI® Stormaster ESE Terminals

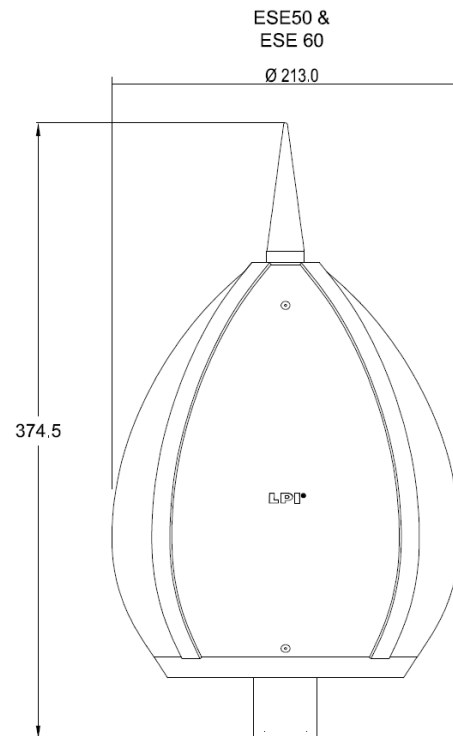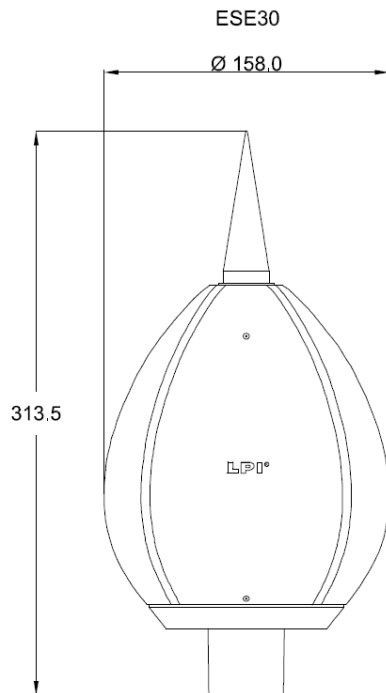

ORDERING CODE	MATERIAL	WEIGHT (KG)	COLOUR	INSULATION MATERIAL
STORMASTER-ESE-15-SS	Stainless steel	0.921	Silver	UV rated evoprene
STORMASTER-ESE-30-SS	Stainless steel	1.45	Silver	UV rated evoprene
STORMASTER-ESE-50-SS	Stainless steel	2.58	Silver	UV rated evoprene
STORMASTER-ESE-60-SS	Stainless steel	2.58	Silver	UV rated evoprene



* For connection to 2" GI Pipe add "GI" to end of Ordering Code (See pages 8 & 12 for more detail)

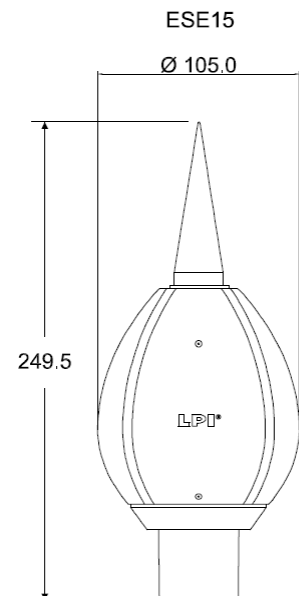

All dimensions are given in mm UNO

TECHNICAL DATA SHEET

LPI® Stormaster ESE Terminals

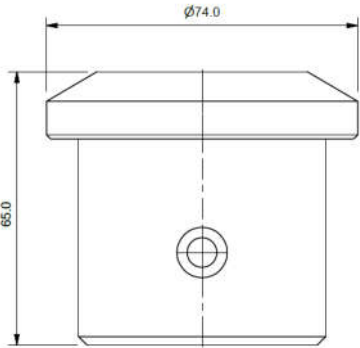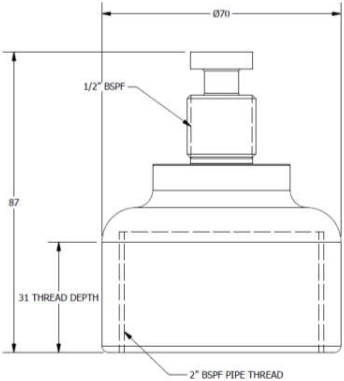Standard Adaptor	GI Adaptor
- For use with FRP mast & HVSC Plus downconductor - Lug Connection to HVSC Plus completed with upper termination 	- Threaded GI adaptor - Female thread 2 inch BSP for connection to GI pipe 

Stormaster ESE Tester

	- Spark-over tester designed for testing the Guardian Plus range of terminals - Portable tester - Visual identification of terminal operation - Rechargeable batteries
Ordering Code	AIR TERMINAL TESTER
Description:	LPI® Guardian Plus terminal tester
Construction:	Plastic enclosure
Charger operating voltage:	100 – 240 V
Batteries:	4 x 1.2 V rechargeable NiCad batteries
Dimension:	115 x 90 x 55 mm
Weight:	0.5 kg

